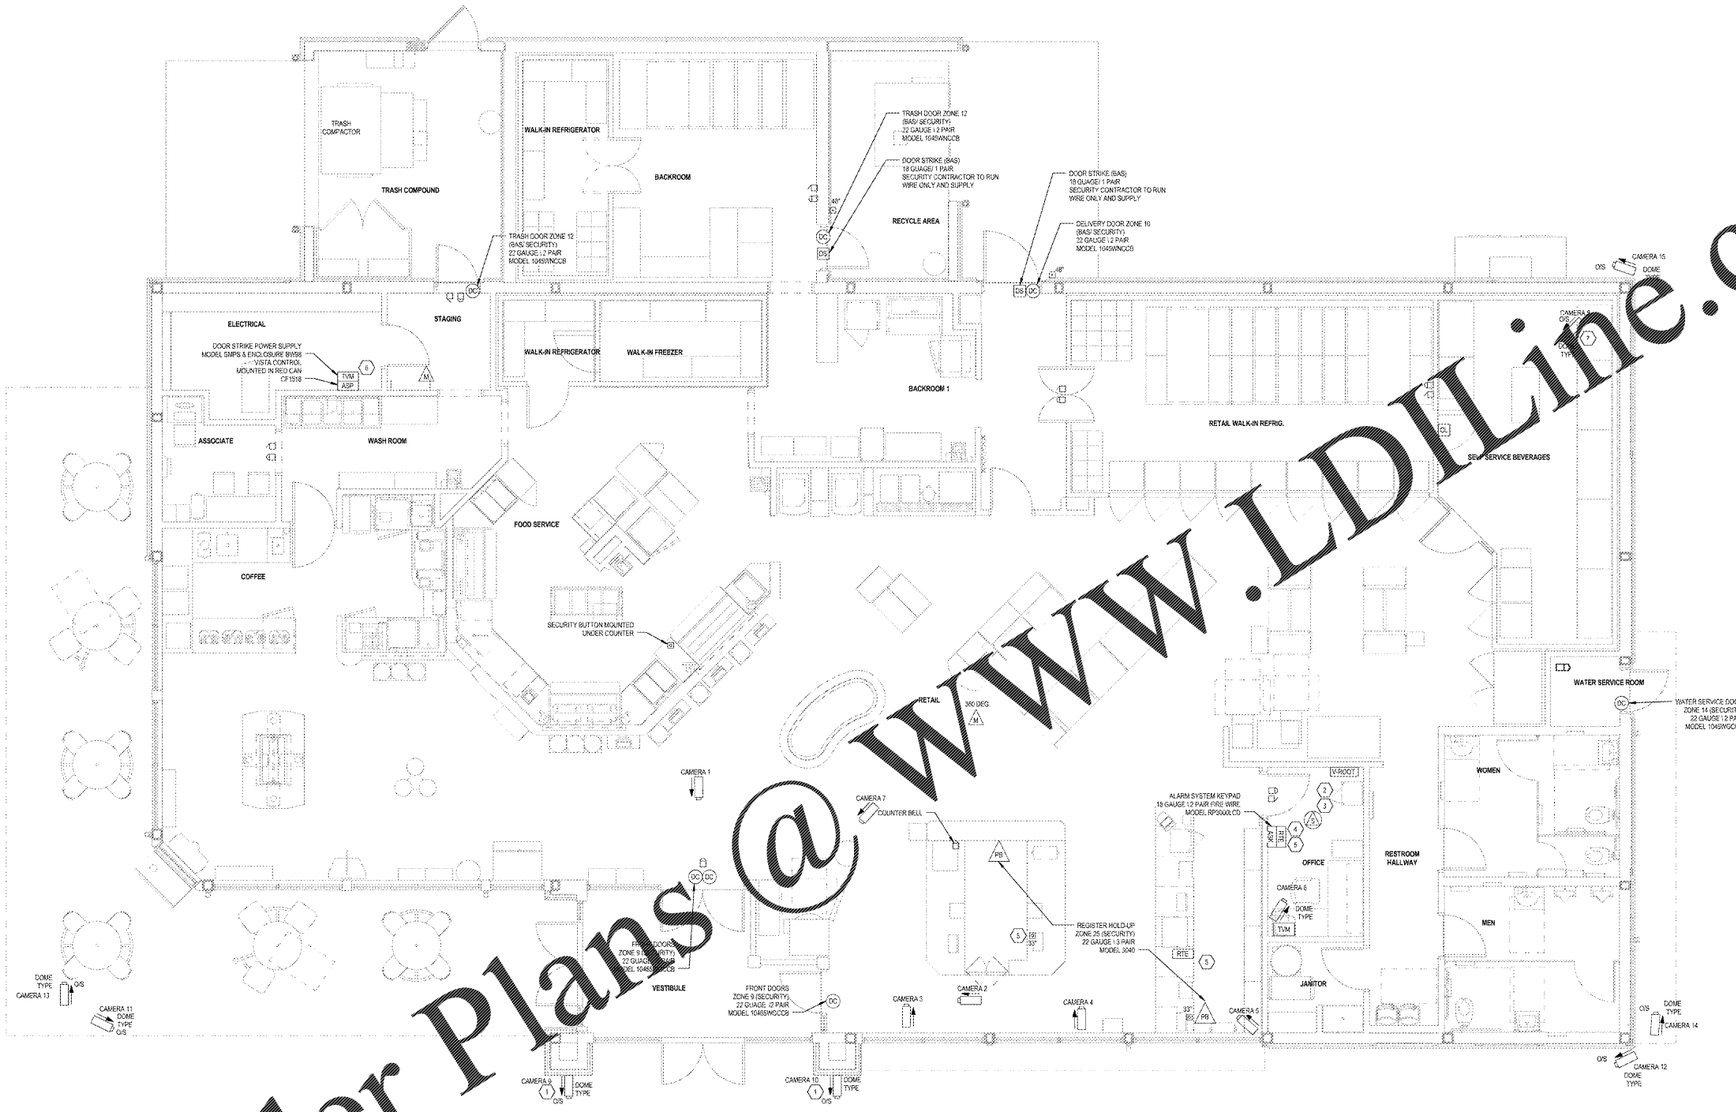

1 SECURITY SYSTEM DEVICE PLAN

GENERAL NOTES:

1. ALL SECURITY SYSTEM PANELS, DEVICES, CAMERAS, SPEAKERS, AND ASSOCIATED WIRING SUPPPLIED AND INSTALLED BY WAWA SECURITY CONTRACTOR.
2. CONNNECTION BETWEEN SECURITY CAMERA SYSTEM AND FIRE ALARM SYSTEM PANEL SHALL BE 4 12 GUAGE \ 2 PAIR.
3. ELECTRICAL CONTRACTOR SHALL PROVIDE (1) 18-2 AND (1)RG-59 COAX CABLE TO EACH SECURITY CAMERA FROM CAMERA POWER SUPPLY. PROVIDE 2 WHITE 18-2 CONDUCTORS FOR POWER SUPPLY.
4. PHONE LINES PROVIDED BY OTHERS. E.C. TO PROVIDE CONDUIT, BOX AND PULL STRING TO ACCESSIBLE CEILING SPACE ABOVE.
5. EXTERIOR WALL MOUNTED CAMERAS (NOT UNDER CANOPIES) TO BE MOUNTED AT HEIGHT OF 14 FEET.

KEYNOTES: (X)

1. SECURITY CONTRACTOR TO MOUNT CAMERAS 9 AND 10 VIEWING GAS PUMPS. SEE SHEET E1 FOR CAMERA INSTALLATION DETAILS.
2. FOR EXACT LOCATION OF [illegible]S IN MAIN OFFICE SEE ARCHITECTURAL PLANS.
3. SECURITY CONTRACTOR SHALL MOUNT SECURITY SPEAKER ABOVE OFFICE DOOR. SECURED TO [illegible] OR METAL STUD. 18 GUAGE WIRE.
4. TRUCK DOOR SECURITY [illegible] RELEASE BUTTON MOUNTED IN OFFICE. SECOND SWITCH MOUNTED TO THE RIGHT OF DOOR OPENING IN FRONT CABINET. [illegible] DELAY NEEDED WITH BAS SYSTEM)
5. DELIVERY DOOR DOOR RELEASE BUTTON MOUNTED IN OFFICE [illegible] SECURITY KEYPAD. SECOND SWITCH MOUNTED TO THE LEFT OF DOOR OPENING IN FIRST CABINET.
6. SECURITY CONTRACTOR SHALL MOUNT SECURITY PANELS 96" FROM FLOOR. FIELD COORDINATE EXACT LOCATION.
7. FOR SELF SERV WALK-IN CAMERA, PROVIDE O/S TYPE RATED FOR COOLER TEMPERATURE.

LEGEND

	PUSH BUTTON BUZZER (EXTERIOR)
	PUSH BUTTON BELL (INTERIOR)
	BUZZER (EXTERIOR) / BELL (INTERIOR)
CH	CHIME
ASP	SECURITY SYSTEM PANEL
ASK	SECURITY SYSTEM KEYPAD
PETROT	PETROLEUM ALARM
DC	DOOR CONTACT
M	MOTION DETECTOR
PB	PANIC BUTTON
PPB	PANIC BUTTON WITH LEAD
S	SECURITY SPEAKER
TVM	DOOR STRIKE POWER SUPPLY
DS	DOOR STRIKE
RTE	REQUEST TO ENTER
	CAMERA (SHOWING DIRECTION)
O/S	CAMERA (OUTSIDE RATED FOR TEMPERATURE AND WEATHER)
CL	MAGNETIC DOOR LOCK
TVM	MONITOR FOR CAMERAS (CCTV)

WWW.LDILine.com
Order Plans @

Cuhaci & Peterson Architects Engineers Planners
Retail Corporate Excellence 4-4-21 (CAMBER)
1925 Prospect Avenue, Orlando, FL 32814
Ph. 407-661-9160 Fax 407-661-9161 www.c-p.com

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F110L 2018.01 STORE #5337 - MRC
SE MARICAMP RD. & SE 24th ST.
OCALA, FL

SHEET TITLE
SECURITY PLAN

Revision Schedule		
No.	Description	Date
	PERMIT SET	07/20/2017
A	REV. 2018.01	10/03/2018
	PRE-BID REVIEW SET	10/03/2018
	BID SET	10/23/2018

PROJECT NO. 2170050
DATE 08/04/2017
DRAWN MLB
CHECKED JAE

E9

COPYRIGHT: All reports, plans, specifications, computer files, and other documents and instruments prepared by Cuhaci & Peterson Architects Engineers Planners, P.A. (C&P) are copyrighted works of C&P and as such are protected by U.S. copyright laws and other applicable laws. Any unauthorized use, reuse, modification, reproduction, display, distribution, or transmission of any document without the express written permission of C&P is prohibited. Unauthorized use of these documents will be subject to legal action, including claims for damages and attorneys' fees and costs.