

Copyright © All rights reserved. Computer files, CAD data, notes and other documents are instruments of service prepared by Harris Teeter, Inc. or its affiliates. All other documents are instruments of service prepared by others. Harris Teeter, Inc. or its affiliates shall retain all copyright and other reserved rights, including the copyright therein. Any use or reproduction of this document without written permission from Harris Teeter, Inc. is a violation of Federal Copyright Law.

MF88 Board #1 (I) Rack A	MF88 Board #2 (I) Rack A	MF88 Board #3 (I) Rack A	MF88 Board #4 (I) Rack A	MF88 Board #5 (I) Rack A	MF88 Board #6 (I) Rack A	MF88 Board #7 (I) Rack A
MF88 Board #8 (I) Rack A	MF88 Board #9 (I) Rack A	MF88 Board #10 (I) Rack A	MF88 Board #11 (I) Rack A	MF88 Board #12 (I) Rack A	MF88 Board #13 (I) Rack A	MF88 Board #14 (I) Rack A
MF88 Board #15 (I) Rack A	MF88 Board #16 (I) Rack A	MF88 Board #17 (I) Rack A	MF88 Board #18 (I) Rack A	MF88 Board #19 (I) Rack A	MF88 Board #20 (I) Rack A	MF88 Board #21 (I) Rack A

1 INPUT / OUTPUT SCHEDULE - RACK 'A'

MF88 Board #1 (I) Rack A	MF88 Board #2 (I) Rack A	MF88 Board #3 (I) Rack A	MF88 Board #4 (I) Rack A	MF88 Board #5 (I) Rack A	MF88 Board #6 (I) Rack A	MF88 Board #7 (I) Rack A
MF88 Board #8 (I) Rack A	MF88 Board #9 (I) Rack A	MF88 Board #10 (I) Rack A	MF88 Board #11 (I) Rack A	MF88 Board #12 (I) Rack A	MF88 Board #13 (I) Rack A	MF88 Board #14 (I) Rack A
MF88 Board #15 (I) Rack A	MF88 Board #16 (I) Rack A	MF88 Board #17 (I) Rack A	MF88 Board #18 (I) Rack A	MF88 Board #19 (I) Rack A	MF88 Board #20 (I) Rack A	MF88 Board #21 (I) Rack A


3 INPUT / OUTPUT SCHEDULE - HVAC / LIGHTING

MF88 Board #1 (I) Rack B	MF88 Board #2 (I) Rack B	MF88 Board #3 (I) Rack B	MF88 Board #4 (I) Rack B	MF88 Board #5 (I) Rack B	MF88 Board #6 (I) Rack B	MF88 Board #7 (I) Rack B
MF88 Board #8 (I) Rack B	MF88 Board #9 (I) Rack B	MF88 Board #10 (I) Rack B	MF88 Board #11 (I) Rack B	MF88 Board #12 (I) Rack B	MF88 Board #13 (I) Rack B	MF88 Board #14 (I) Rack B
MF88 Board #15 (I) Rack B	MF88 Board #16 (I) Rack B	MF88 Board #17 (I) Rack B	MF88 Board #18 (I) Rack B	MF88 Board #19 (I) Rack B	MF88 Board #20 (I) Rack B	MF88 Board #21 (I) Rack B


2 INPUT / OUTPUT SCHEDULE - RACK 'B'

MF88 Board #1 (I) Rack B	MF88 Board #2 (I) Rack B	MF88 Board #3 (I) Rack B	MF88 Board #4 (I) Rack B	MF88 Board #5 (I) Rack B	MF88 Board #6 (I) Rack B	MF88 Board #7 (I) Rack B
MF88 Board #8 (I) Rack B	MF88 Board #9 (I) Rack B	MF88 Board #10 (I) Rack B	MF88 Board #11 (I) Rack B	MF88 Board #12 (I) Rack B	MF88 Board #13 (I) Rack B	MF88 Board #14 (I) Rack B
MF88 Board #15 (I) Rack B	MF88 Board #16 (I) Rack B	MF88 Board #17 (I) Rack B	MF88 Board #18 (I) Rack B	MF88 Board #19 (I) Rack B	MF88 Board #20 (I) Rack B	MF88 Board #21 (I) Rack B


4 REFRIGERATED CASE EMS CONDUIT ROUTING DETAILS

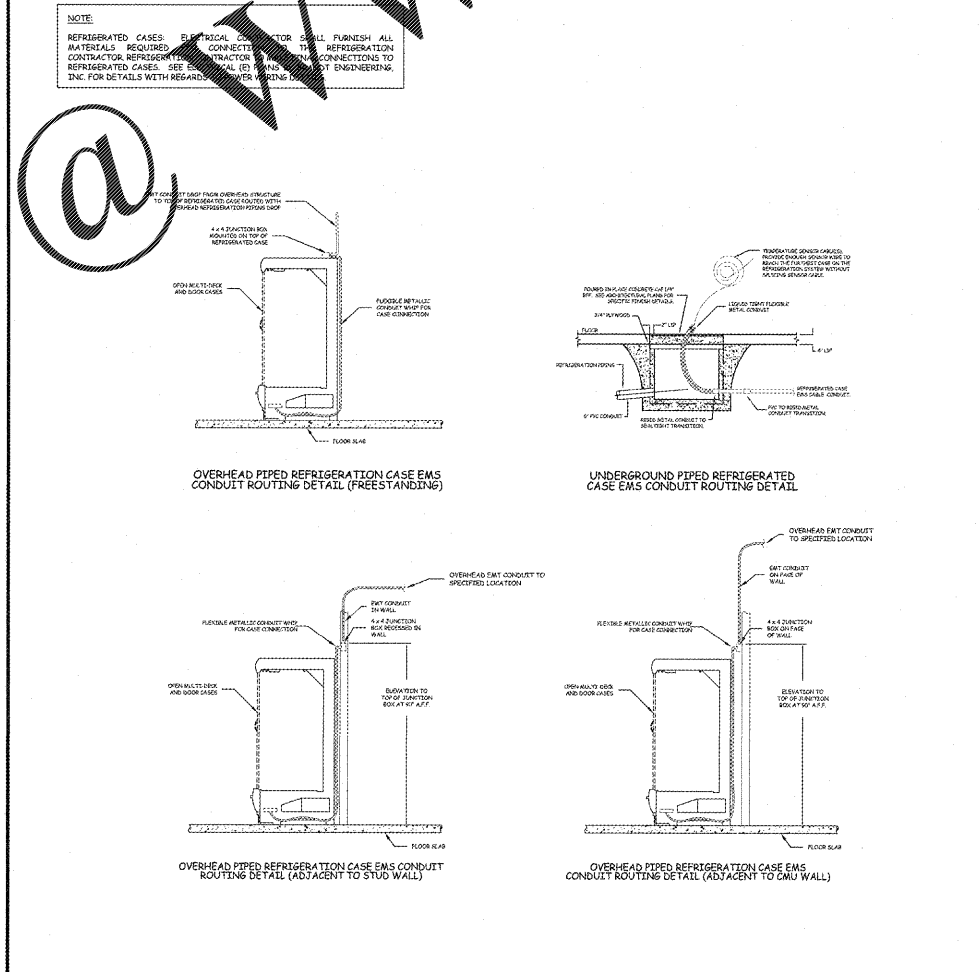


8 REFRIGERATION LDS ALARM / SHUTDOWN WIRING

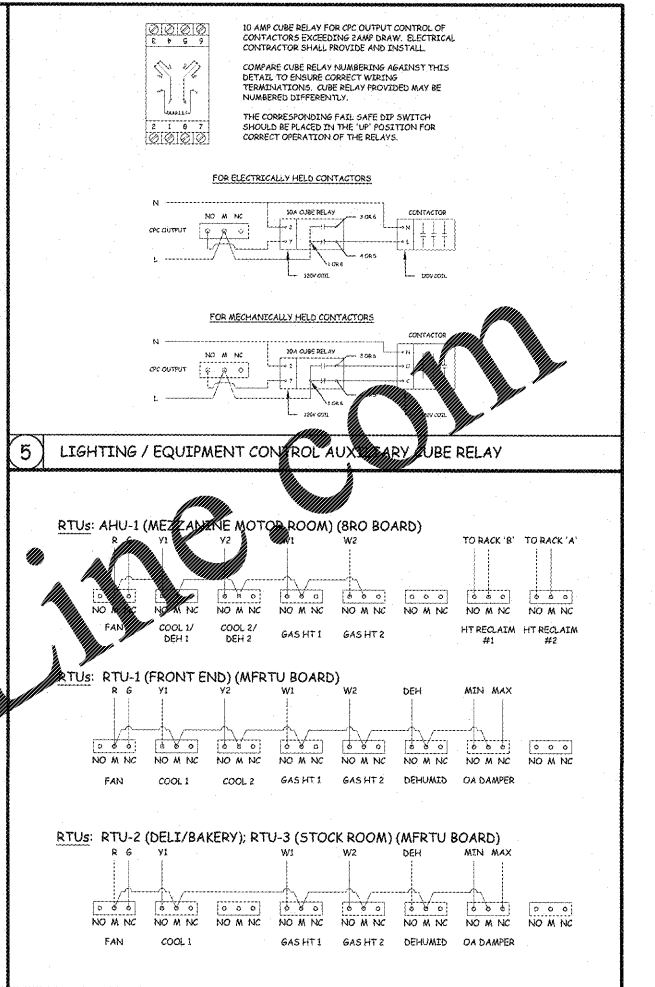

6 OUTPUT WIRING TERMINATIONS AT ROOFTOP / AHU UNITS

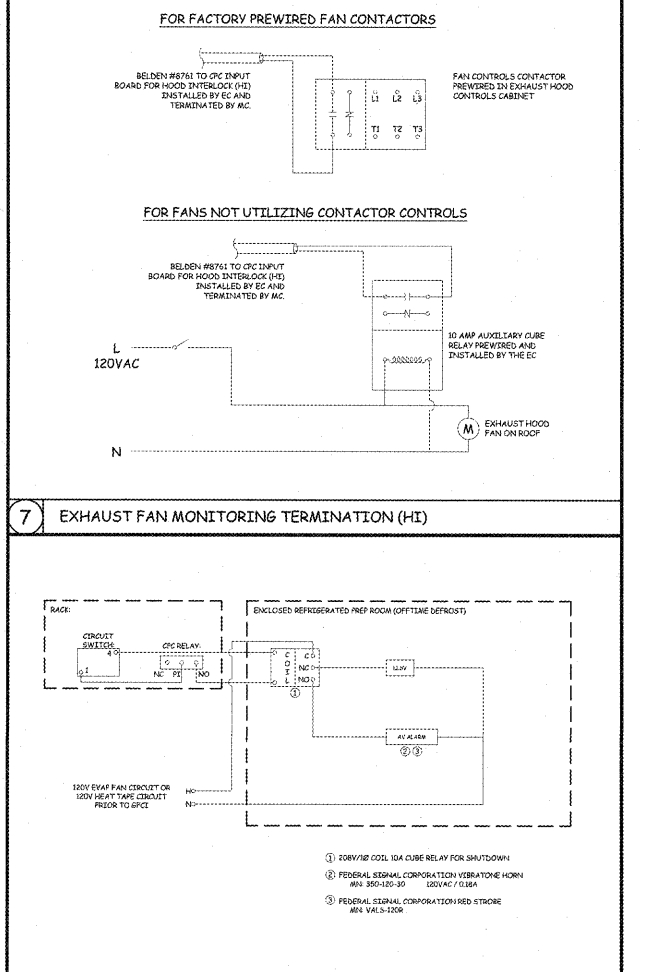

8 REFRIGERATION LDS ALARM / SHUTDOWN WIRING

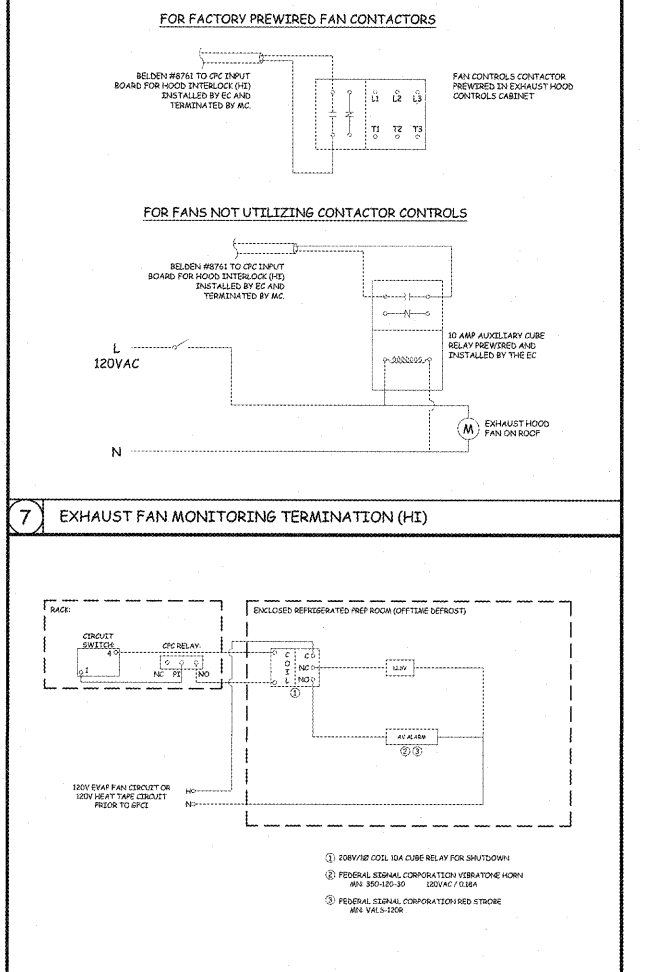

DATE: SEPTEMBER 10, 2019 Job No. 1922

BONDURANT ASSOCIATES ARCHITECTURE & ENGINEERING

Harris Teeter
Neighborhood Food & Pharmacy

HARRIS TEETER STORE #239 - REMODEL
2603 GLENWOOD AVENUE, SUITE 101
RALEIGH, NC 27608
ENERGY MANAGEMENT CONTROL SCHEDULES AND DETAILS

EM4.1
Sheet 4 of 4